


Applicant: US MGO COMPANY, LLC
Product: INNOVATION MGO WALL PANELS
Standard: ASTM E119 (UL 263)
Assembly Rating: 2-Hour
Load: Load Bearing (100% Design Load) – See Conditions of Listing Item #5
MOS = Magnesium Oxide Sheathing

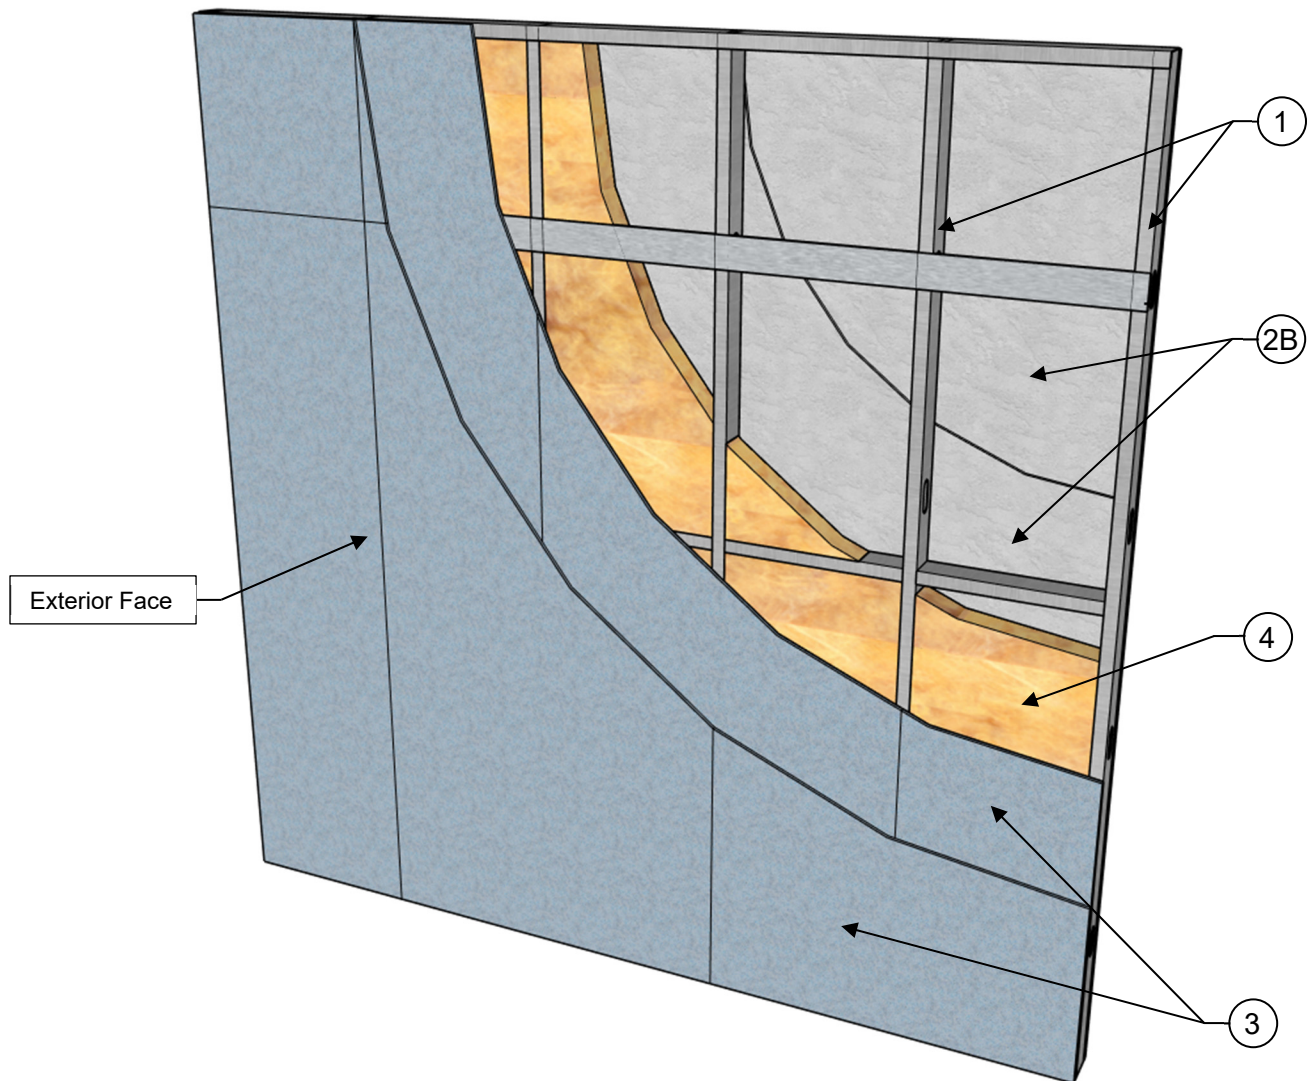

COMPONENTS OF CONSTRUCTION:

ITEM NO.	COMPONENTS	MATERIALS
1	Cold-Formed Steel Structural Members—	<p>Minimum 3 ⁵/₈-inch (92 mm) deep, minimum 20 gauge (37.5 mils), corrosion-protected or galvanized steel channel-shaped studs with a governing slenderness ratio (I_y/d) of 37, spaced maximum 24 inches (609.6 mm) on center, with bracing at mid-height in the weak-axis direction, are secured to top and bottom track members (with same gauge thickness as studs) with ¹/₂-inch (12.7 mm) long No. 8 wafer head self-drill screws. Steel studs must have minimum 1 ⁵/₈-inch (41.3 mm) flanges and ¹/₂-inch (12.7 mm) return. Minimum 16-gauge (62.5 mils) galvanized steel channel bracing, with 1 ¹/₂-inch (38.1 mm) flanges and ¹/₂-inch (12.7 mm) legs, is installed between each stud at mid-height of the wall assembly and attached with 16 gauge (62.5 mils) thick 1 ¹/₂-inch by 1 ¹/₂-inch (38.1 mm by 38.1 mm) galvanized steel angles at each end with two ¹/₂-inch (12.7 mm) long No. 8 pan head self-drilling screws. Minimum 4 inch (101.6 mm) wide, minimum 20 gauge (37.5 mils) thick steel flat strapping plate, used as blocking at sheathing horizontal seams, is installed between each stud 24 inches (609.6 mm) from the top of the wall assembly and 24 inches (609.6 mm) from the bottom of the wall assembly and secured with two ¹/₂-inch (12.7 mm) Type S-12 low profile panhead screws.</p> <p>Note: See Condition of Listing Item 5 of ESL-1610.</p>
2	Interior Sheathing— Use either A or B	<p>A — Interior Sheathing (MgO) – Two layers of nominal ¹/₂-inch (12 mm actual) thick INNOVATION MgO Wall Panels are secured directly to the base wall system framing, on the interior side of the wall assembly.</p> <p>The base layer must be secured to the framing using minimum 1 ¹/₄-inch (31.8 mm) long No. 8 fine thread, flat wafer head cement board screws spaced at 8 inches (203.2 mm) on center along the perimeter and in the field of the panel. Base layer may be installed vertically or horizontally to the studs. All vertical seams must fall on studs and must be staggered from one side of the assembly to the opposite sides of the assembly by a minimum of one stud cavity. All horizontal seams must be backed by blocking and staggered from one side of the assembly to the opposite sides of the assembly by a minimum of 12 inches (304.8 mm).</p> <p>The face layer, with vertical and horizontal panel joints staggered from the base layer, must be secured to the framing using 1 ⁵/₈-inch (41.3 mm) long No. 8 fine thread, flat wafer head cement board screws spaced at 8 inches (203.2 mm) on center along the perimeter and in the field, with the face layer screws staggered 4 inches (101.6 mm) from the base layer screws. Face layer may be installed vertically or horizontally to the studs. All vertical seams must fall on studs and must be staggered from one side of the assembly to the opposite sides of the assembly by a minimum of one stud cavity. INNOVATION MgO Wall Panel edge joints are permitted to be left uncovered without joint compound. Fastener heads are permitted to be left exposed.</p> <p>B — Interior Sheathing (GWB) – Two layers of minimum ⁵/₈-inch (15.9 mm) Type X or Type C gypsum wallboard, complying with ASTM C1396, are secured directly to the base wall system framing, on the interior side of the wall assembly.</p> <p>The base layer must be secured to the framing using minimum 1 ³/₈-inch (34.9 mm) long Type S screws (minimum ³/₄-inch (19.1 mm) fastener penetration into framing members) spaced at 8 inches (203.2 mm) on center along the perimeter and in the field of the panel. Gypsum wallboard must be installed vertically to the studs. All vertical seams must fall on studs and must be staggered from one side of the assembly to the opposite sides of the assembly.</p> <p>The face layer, with vertical panel joints staggered from the base layer, must be secured to the framing using 1 ⁷/₈-inch (47.6 mm) long Type S screws (minimum ⁵/₈-inch (15.9 mm) fastener penetration into framing members) spaced at 8 inches (203.2 mm) on center along the perimeter and in the field, with the face layer screws staggered 4 inches (101.6 mm) from the base layer screws. Face layer must be installed vertically to the studs. All vertical seams must fall on studs and must be staggered from one side of the assembly to the opposite sides of the assembly by a minimum of one stud cavity. All face layer sheathing joints edge joints must be treated with two coats of joint compound with nominal 2-inch wide paper tape embedded in first layer of compound over all joints. All fastener heads must be covered with one layer of joint compound.</p>
3	Exterior Sheathing—	<p>Two layers of nominal ¹/₂-inch (12 mm actual) thick INNOVATION MgO Wall Panels are secured directly to the base wall system framing, on the interior side of the wall assembly.</p> <p>The base layer must be secured to the framing using minimum 1 ¹/₄-inch (31.8 mm) long No. 8 fine thread, flat wafer head cement board screws spaced at 8 inches (203.2 mm) on center along the perimeter and in the field of the panel. Base layer may be installed vertically or horizontally to the studs. All vertical seams must fall on studs and must be staggered from one side of the assembly to the opposite sides of the assembly by a minimum of one stud cavity. All horizontal seams must be backed by blocking and staggered from one side of the assembly to the opposite sides of the assembly by a minimum of 12 inches (304.8 mm).</p> <p>The face layer, with vertical and horizontal panel joints staggered from the base layer, must be secured to the framing using 1 ⁵/₈-inch (41.3 mm) long No. 8 fine thread, flat wafer head cement board screws spaced at 8 inches (203.2 mm) on center along the perimeter and in the field, with the face layer screws staggered</p>

ITEM NO.	COMPONENTS	MATERIALS
		4 inches (101.6 mm) from the base layer screws. Face layer may be installed vertically or horizontally to the studs. All vertical seams must fall on studs and must be staggered from one side of the assembly to the opposite sides of the assembly by a minimum of one stud cavity. INNOVATION MgO Wall Panel edge joints are permitted to be left uncovered without joint compound. Fastener heads are permitted to be left exposed.
4	Cavity Insulation— Use either A or B	<p>A — Minimum R-13 fiberglass batt insulation, bearing the UL Classification Marking for surface burning and/or fire resistance, with nominal thickness of $3 \frac{5}{8}$-inch (92.1 mm) is friction-fit into each stud cavity. The insulation thickness must match the stud cavity depth.</p> <p>B — Minimum R-13 mineral wool insulation, bearing the UL Classification Marking for surface burning and/or fire resistance, with a nominal thickness of $3 \frac{5}{8}$-inch (92.1 mm) and a minimum density of 2.0 lbs./ft³ (32 kg/m³) is friction-fit into each stud cavity. The insulation thickness must match the stud cavity depth.</p>
5	Exterior Facing Assembly (Not Shown)—	Where the assembly is used as an exterior wall, any exterior facing may be included, as authorized by the authority having jurisdiction, and must be installed in accordance with the manufacturer's installation instructions.

For SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm, 1 lbs./ft³ = 16.01 kg/m³.