

# ICC Design No. WPC-1302-04

**ESL-1302**

Reissued July 2023

This listing is subject to renewal July 2024.

[www.icc-es.org](http://www.icc-es.org) | (800) 423-6587 | (562) 699-0543

A Subsidiary of the International Code Council®

**Applicant:** DUPONT DE NEMOURS, INC.

**Product:** DUPONT™ ARMORWALL AND DUPONT™ ARMORWALL PLUS STRUCTURAL INSULATED SHEATHING: 2-INCH, 2 3/4-INCH, AND 3 3/4-INCH THICK PANELS


**Standard:** ASTM E119 (UL 263) / CAN/ULC-S101

**Assembly**

**Rating:** 2-Hour

**Load:** Load Bearing – See Conditions of Listing Note #6

WPC = Wood, Plastics and Composites

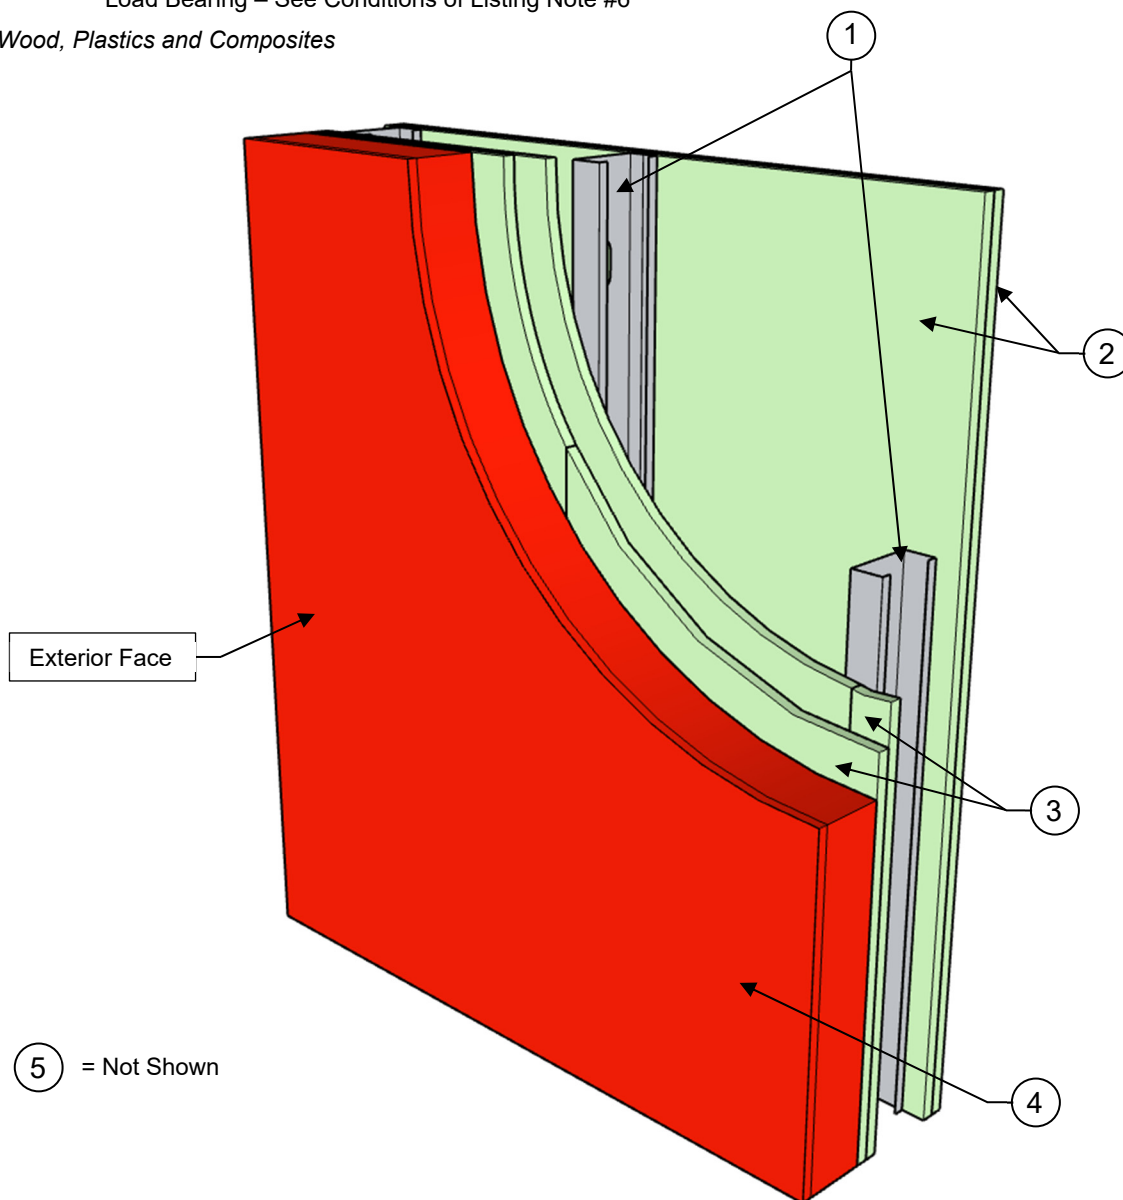

## COMPONENTS OF CONSTRUCTION:

Listings are not to be construed as representing aesthetics or any other attributes not specifically addressed, nor are they to be construed as an endorsement of the subject of the listing or a recommendation for its use. There is no warranty by ICC Evaluation Service, LLC, express or implied, as to any finding or other matter in this listing, or as to any product covered by the listing.

1. **Cold-Formed Steel Structural Members** – Minimum 3 <sup>5</sup>/<sub>8</sub>-inch (92 mm) deep, minimum 20 gauge (37.5 mils), corrosion-protected or galvanized steel channel-shaped studs spaced maximum 24 inches (609.6 mm) on center installed into same gauge thick track at top and bottom of wall (track not shown). Steel studs must have minimum 1 <sup>5</sup>/<sub>8</sub>-inch (41.3 mm) flanges and <sup>1</sup>/<sub>2</sub>-inch (12.7 mm) return. Steel studs must be secured to the track framing with <sup>1</sup>/<sub>2</sub>-inch (12.7 mm) Type S-12 screws. 16-gauge (62.5 mils) steel channel blocking, 1 <sup>1</sup>/<sub>2</sub>-inch (38.1 mm) wide with <sup>1</sup>/<sub>4</sub>-inch (6.4 mm) legs, is installed mid-height of the wall along the length of the wall (blocking not shown). Steel channel blocking is attached with 16 gauge (62.5 mils) 2-inch x 2-inch (50.8 mm x 50.8 mm) galvanized steel angles at each end with two #6 x <sup>1</sup>/<sub>2</sub>-inch (12.7 mm) self-drilling screws.

Note: See Conditions of Listing Items 5, 6 and 8 of [ESL-1302](#).

2. **Interior Sheathing (Gypsum Wallboard)** – Two layers of minimum <sup>5</sup>/<sub>8</sub>-inch (15.9 mm) thick Type X gypsum wallboard with beveled edges are secured directly to the base wall system framing, on the interior side of the wall assembly. The base layer must be secured to the framing using 1 <sup>1</sup>/<sub>4</sub>-inch (31.8 mm) long Type S screws spaced at 12 inches (304.8 mm) on center along the perimeter and in the field of the gypsum wallboard. The face layer, with vertical panel joints staggered from the base layer, must be secured to the framing using 1 <sup>7</sup>/<sub>8</sub>-inch (47.6 mm) long Type S screws spaced at 12 inches (304.8 mm) on center along the perimeter and in the field, with the face layer screws staggered 6 inches (152.4 mm) from the base layer screws. Gypsum wallboard may be installed vertically or horizontally to the studs. All vertical seams must fall on studs and must be staggered from one side of the assembly to the opposite sides of the assembly. All face layer sheathing joints must be treated with two coats of joint compound with nominal 2-inch wide paper tape embedded in first layer of compound over all joints. All fastener heads must be covered with one layer of joint compound.
3. **Exterior Sheathing (Gypsum Wallboard)** – Two layers of minimum <sup>5</sup>/<sub>8</sub>-inch (15.9 mm) thick Type X gypsum wallboard with beveled edges are secured directly to the base wall system framing, on the exterior side of the wall assembly. The base layer must be secured to the framing using 1 <sup>1</sup>/<sub>4</sub>-inch (31.8 mm) long Type S screws spaced at 12 inches (304.8 mm) on center along the perimeter and in the field of the gypsum wallboard. The face layer, with vertical panel joints staggered from the base layer, must be secured to the framing using 1 <sup>7</sup>/<sub>8</sub>-inch (47.6 mm) long Type S screws spaced at 12 inches (304.8 mm) on center along the perimeter and in the field, with the face layer screws staggered 6 inches (152.4 mm) from the base layer screws. Gypsum wallboard may be installed vertically or horizontally to the studs. All vertical seams must fall on studs and must be staggered from one side of the assembly to the opposite sides of the assembly. All face layer sheathing joints must be treated with two coats of joint compound with nominal 2-inch wide paper tape embedded in first layer of compound over all joints. All fastener heads must be covered with one layer of joint compound.
4. **Exterior Sheathing (DuPont™ ArmorWall)** – One layer of maximum 3 <sup>3</sup>/<sub>4</sub>-inch (95.3 mm) thick DuPont™ ArmorWall or DuPont™ ArmorWall Plus Structural Insulated Sheathing is secured through the face and base layers of gypsum wallboard to the base wall system framing, on the exterior side of the wall assembly with the insulation layer of the panel facing inward, using minimum 6-inch (152.4 mm) long #14-13 DP1 concealer pancake head self-drilling screws spaced 12 inches (304.8 mm) on center along the perimeter and in the field. DuPont™ ArmorWall and DuPont™ ArmorWall Plus panels may be installed vertically or horizontally to the studs. All vertical seams must fall on studs and must be staggered from one side of the assembly to the opposite sides of the assembly. Joints and fastener heads must be treated with one layer of DuPont™ ArmorSeal Sealant.

Note: Where one layer of 2-inch (50.8 mm) or 2 <sup>3</sup>/<sub>4</sub>-inch (69.9 mm) thick DuPont™ ArmorWall or DuPont™ ArmorWall Plus is used, minimum #14-13 DP1 concealer pancake head self-drilling screw lengths must be minimum 4-inch (101.6 mm) or 5-inch (127 mm) long, respectively.

- 5a. **Insulation** – None
- 5b. **Insulation (Not Shown)** – Optional minimum R-15 mineral wool insulation, bearing the UL Classification Marking for surface burning and/or fire resistance, with nominal thickness of 3 <sup>1</sup>/<sub>2</sub>-inches (88.9 mm) is friction-fit into each stud cavity.
- 5c. **Insulation (Not Shown)** – Optional minimum R-13 glass fiber insulation, bearing the UL Classification Marking for surface burning and/or fire resistance, with nominal thickness of 3 <sup>1</sup>/<sub>2</sub>-inches (88.9 mm) is friction-fit into each stud cavity.
6. **Exterior Facing Assembly (Not Shown)** – Any exterior facing, as authorized by the Authority having jurisdiction and installed in accordance with the manufacturer's installation instructions.